


Daily PM_{2.5} Filter at Hawthorne, Lindon, & Ogden

October 2005

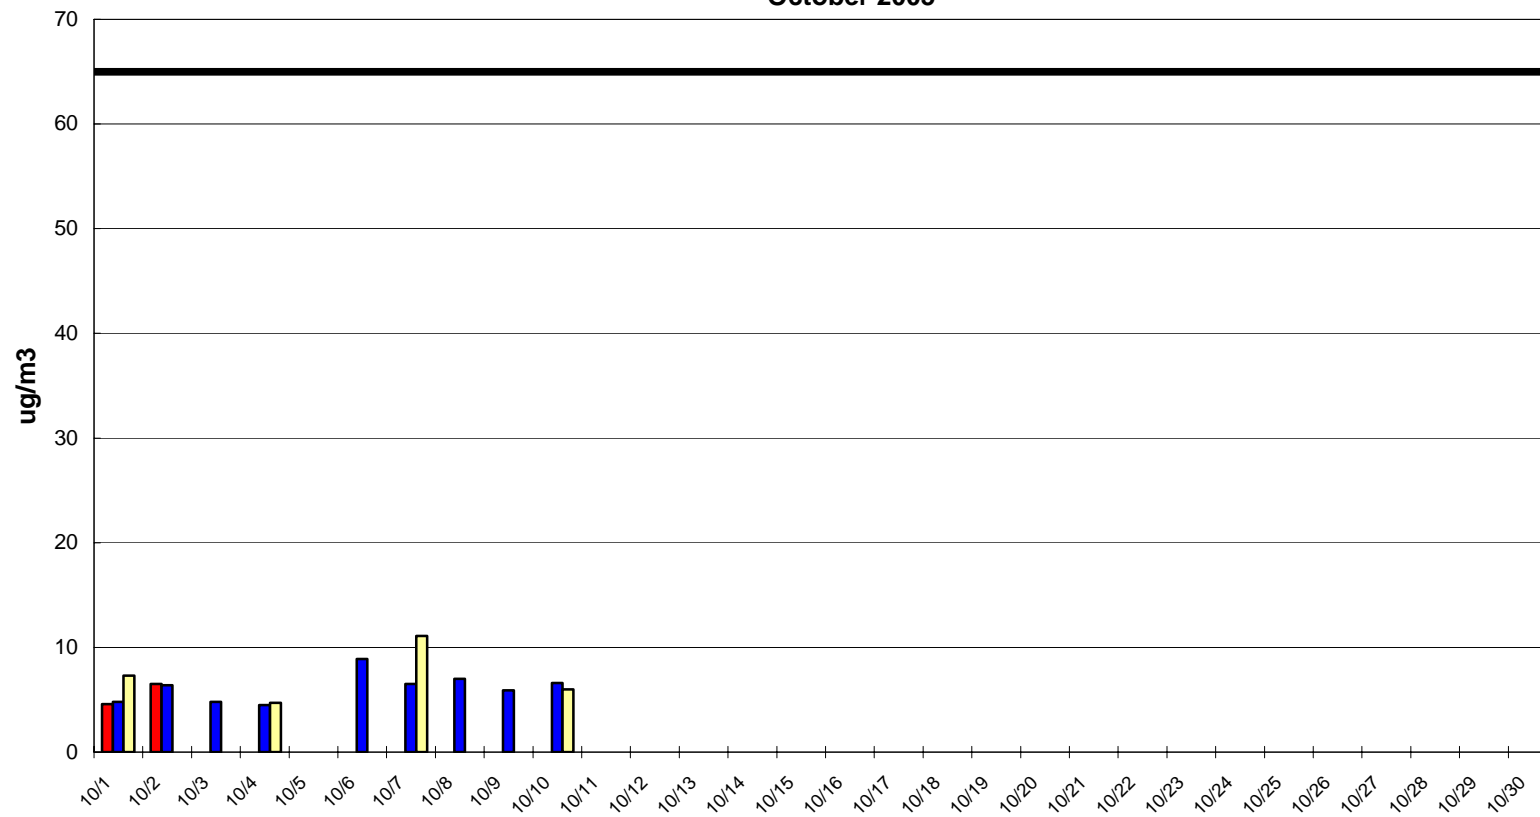

Hawthorne Lindon Ogden PM_{2.5} Standard is 65 $\mu\text{g}/\text{m}^3$